


TOP VIEW

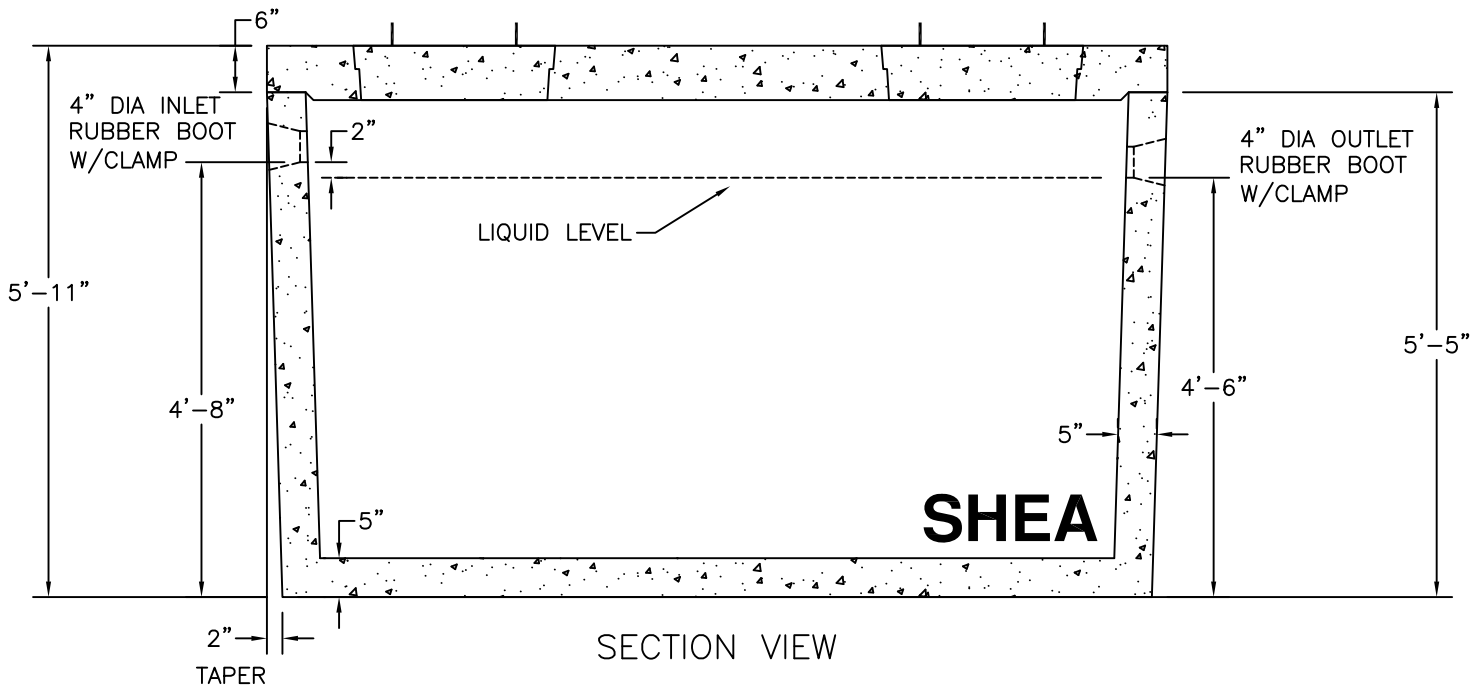

SECTION VIEW

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227.
4. DESIGNED FOR H-20 LOADING.
5. TEES AND GAS BAFFLE SOLD SEPARATELY.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYL RESIN.

WEIGHT:

- BOTTOM = 11,250#
- 10" TOP = 5,960#
- 6" TOP = 3,575#

ITEM NO.	M1000H	H-20 (6" TOP)
	M1000HT10	H-20 (10" TOP)



*New England's Premier Precaster*  
 800-696-7432 (SHEA)  
 www.sheaconcrete.com

1000 GALLON SEPTIC TANK  
 MONOLITHIC 5" WALL - H20

773 Salem Street-Wilmington, MA 153 Cranberry Hwy-Rochester, MA  
 87 Haverhill Road-Amesbury, MA 160 Old Turnpike Rd-Nottingham, NH  
 Mail to: PO Box 520-Wilmington, MA 01887

Page: B2.2

tkM1000-5.dwg

02/01/2013

