


PLAN VIEW

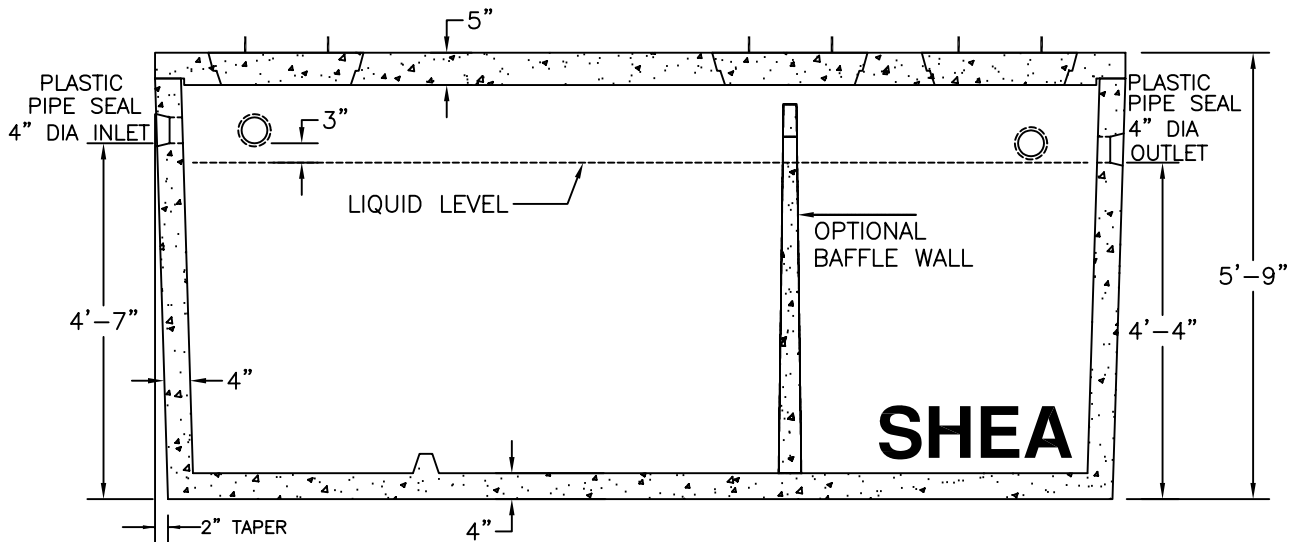

SECTION VIEW

ITEM NO.	TK M2000	WEIGHT
	TK M2000H	17,800#
	TK M20002C	19,800#
	TK M20002CH	19,150#
		21,150#

NOTES:

1. CONCRETE: 4,000 PSI MINIMUM AFTER 28 DAYS.
2. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS, FOR SEPTIC TANKS.
3. ALL REINFORCEMENT PER ASTM C1227-93.
4. BAFFLE WALL OPTIONAL FOR TWO COMPARTMENT TANKS.
5. TEES AND GAS BAFFLE SOLD SEPARATELY.
6. TONGUE & GROOVE JOINT SEALED WITH BUTYLE RESIN.
7. ALSO AVAILABLE IN H-20 LOADING.



SEPTIC TANK MONOLITHIC
2000 GALLON